


| REV. | BY | DATE | DESCRIPTION | APP'D. |
|------|----|----------|--|--------|
| A | ZN | 02/10/06 | ADDED CORRECT WIRE CONNECTORS TO HARNESS | EMK |

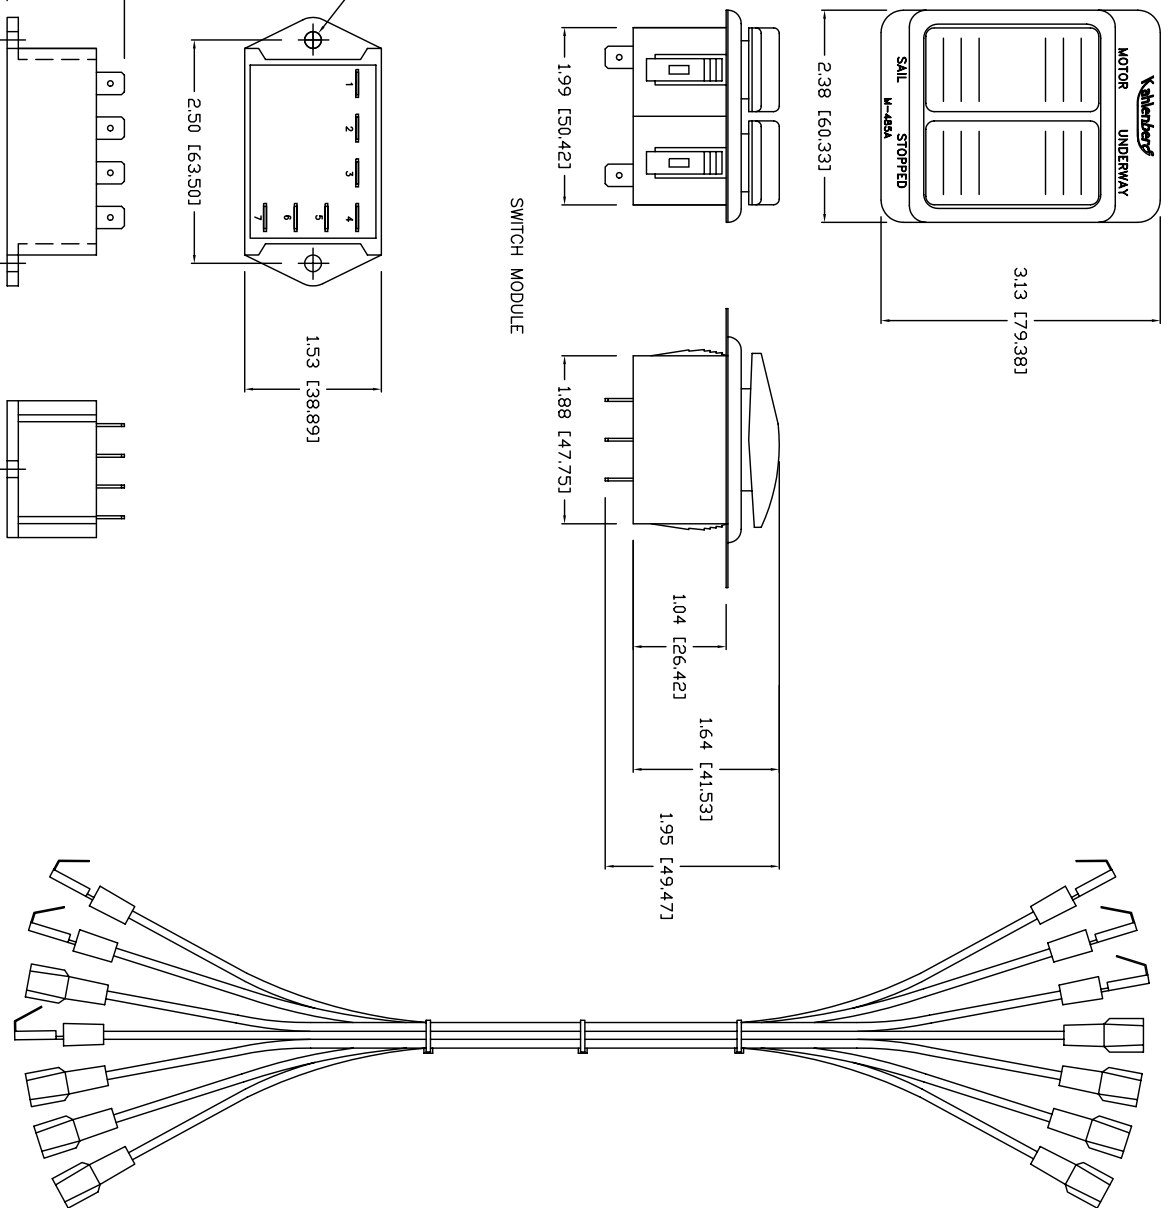

12/24 V.D.C. OPERATION
 Consumes no power when off
 Consumes 6mA in standby mode
 Consumes 75mA when horn is activated
 Drives vessels horns up to 20 Amps

Kahlenberg's
 KAHLENBERG BROS. CO. TWO RIVERS, WISCONSIN 53241

OUTLINE DIMENSIONS
 M-485A FOG SIGNAL
 HORN CONTROL

| DR. | DATE | CKD. | SCALE | DRWG. NO. | REV. |
|-----|----------|------|--------|-----------|------|
| ZN | 06/28/05 | EMK | N.T.S. | 3-6368 | A |

TIMER MODULE

WIRING HARNESS